

Overzicht periode som EDR20 + NL2 in ng/l
individuele metingen

Minimum

12.3

Gemiddeld

15.0

Maximum

16.5


Parameters PFAS drinkwater in ng/l

Parameternaam (kort)	Type parameter	Aantal	Min	Gem	Max
PFBA-L	EDR	24	3.0	3.6	4.6
PFBS-L	EDR	24	1.3	1.7	2.2
PFDA-L	EDR	24	0.0	0.0	0.0
PFDODA-L	EDR	24	0.0	0.0	0.0
PFDODS-L	EDR	24	0.0	0.0	0.0
PFDS-L	EDR	24	0.0	0.0	0.0
PFHpA-L	EDR	24	1.1	1.5	1.8
PFHpS-L	EDR	24	0.0	0.0	0.0
PFHxA-L	EDR	24	2.3	3.0	3.5
PFNS-L	EDR	24	0.0	0.0	0.0
PFPeA-L	EDR	24	2.2	3.0	3.6
PFPeS-L	EDR	24	0.0	0.0	0.0
PFTTrDA-L	EDR	24	0.0	0.0	0.0
PFTTrDS-L	EDR	24	0.0	0.0	0.0
PFUnDA-L	EDR	24	0.0	0.0	0.0
PFUnDS-L	EDR	24	0.0	0.0	0.0
PFHxS-L+V	EFSA-4	24	0.0	0.2	0.3
PFNA-L	EFSA-4	24	0.0	0.0	0.1
PFOA-L+V	EFSA-4	24	1.4	2.1	2.6
PFOS-L+V	EFSA-4	24	0.0	0.0	0.0
DONA	NL	24	0.0	0.0	0.0
HFPO-DA	NL	24	0.0	0.0	0.2

Maand gemiddelde EDR20 + NL2 drinkwater in ng/l

Jaar	2024	2025										
	202412	202501	202502	202503	202504	202505	202506	202507	202508	202509	202510	202511
Som EDR	12.8	13.0	12.5	11.6	11.2	11.5	12.6	13.6	13.6	13.5	13.7	13.6
Som EFSA-4	2.5	2.8	2.7	2.3	2.1	1.7	1.8	1.9	1.9	2.3	2.5	2.6
Som NL2	0.0	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0
Som EDR20 + NL2	15.3	15.9	15.2	13.9	13.3	13.2	14.5	15.5	15.6	15.8	16.2	16.2

Som EDR20 + NL2 drinkwater in ng/l (som onderstaande typen)

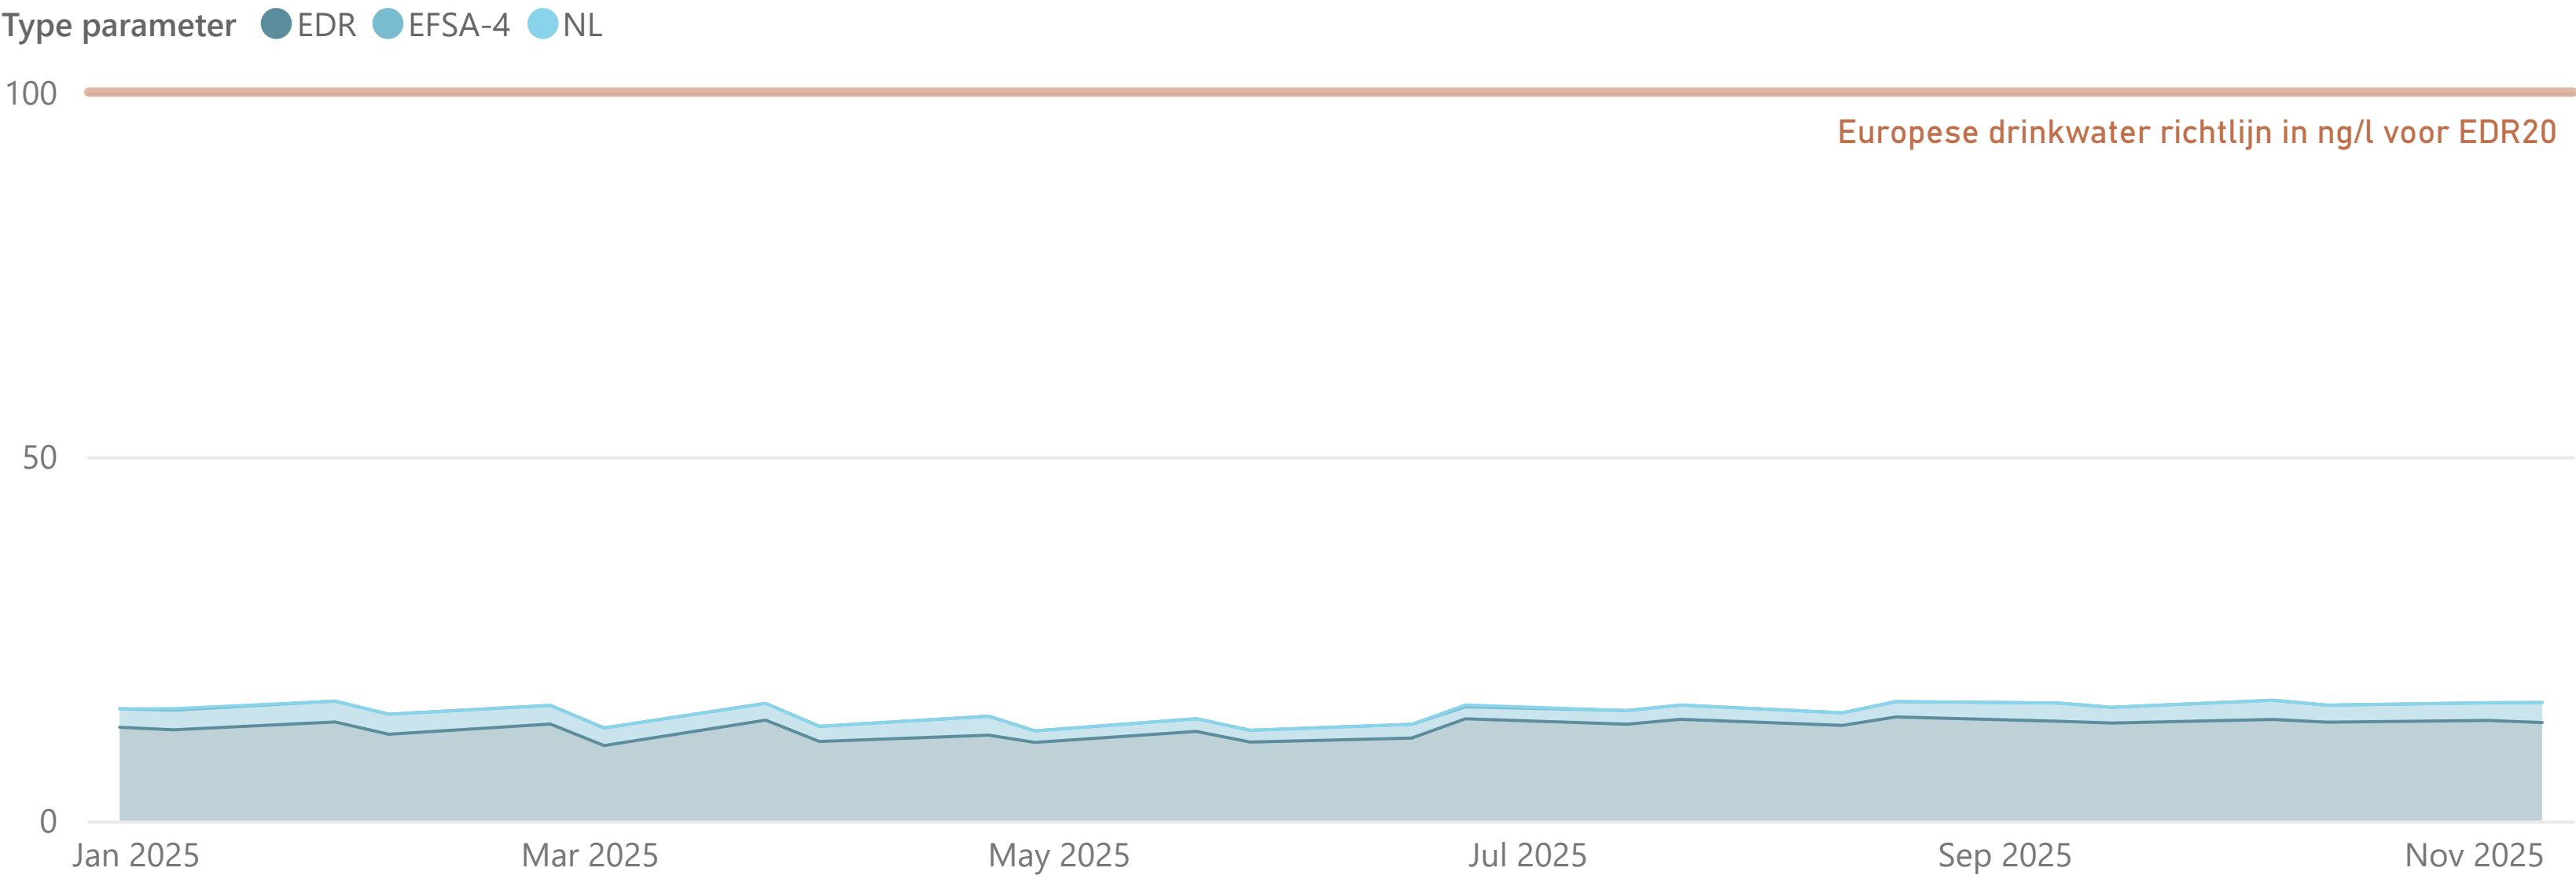

De som EDR20 is een optelling van de som EDR + som EFSA-4

Overzicht periode som EDR20 + NL2 in ng/l PFOA eq
individuele metingen

Minimum

3.0

Gemiddeld

4.0

Maximum

5.4

Maand gemiddelde EDR20 + NL2 drinkwater in ng/l PFOA equivalenten

Jaar	2024	2025										
	202412	202501	202502	202503	202504	202505	202506	202507	202508	202509	202510	202511
Som EDR	1.9	1.8	1.9	1.7	1.6	1.6	1.8	1.8	1.9	1.9	2.0	2.1
Som EFSA-4	3.5	2.7	2.6	2.2	2.0	1.6	1.8	1.9	1.9	2.3	2.4	2.5
Som NL2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Som EDR20 + NL2	5.4	4.5	4.4	3.8	3.6	3.2	3.5	3.6	3.8	4.2	4.4	4.6

Parameters PFAS drinkwater in ng/l PFOA equivalenten

Parameternaam (kort)	Type parameter	Aantal	Min	Gem	Max
PEQ PFBA-L	EDR	24	0.1	0.2	0.2
PEQ PFBS-L	EDR	24	0.0	0.0	0.0
PEQ PFDA-L	EDR	24	0.0	0.0	0.0
PEQ PFDoDA-L	EDR	24	0.0	0.0	0.0
PEQ PFDS-L	EDR	24	0.0	0.0	0.0
PEQ PFHpA-L	EDR	24	1.1	1.5	1.8
PEQ PFHpS-L	EDR	24	0.0	0.0	0.0
PEQ PFHxA-L	EDR	24	0.0	0.0	0.0
PEQ PFPeA-L	EDR	24	0.1	0.1	0.2
PEQ PFPeS-L	EDR	24	0.0	0.0	0.0
PEQ PFTTrDA-L	EDR	24	0.0	0.0	0.0
PEQ PFUnDA-L	EDR	24	0.0	0.0	0.0
PEQ PFHxS-L+V	EFSA-4	24	0.0	0.1	0.2
PEQ PFNA-L	EFSA-4	24	0.0	0.1	1.2
PEQ PFOA-L+V	EFSA-4	24	1.4	2.1	2.6
PEQ PFOS-L+V	EFSA-4	24	0.0	0.0	0.0
PEQ DONA	NL	24	0.0	0.0	0.0
PEQ HFPO-DA	NL	24	0.0	0.0	0.0

Som EDR20 + NL2 drinkwater in ng/l PFOA equivalenten (som onderstaande 3 typen)




De som EDR20 is een optelling van de som EDR + som EFSA-4

TFA drinkwater in ng/l

Parameternaam (kort)	Type parameter	Aantal	Min	Gem	Max
TFA	Totaal	24	940	1,410	2,300

TFA gehalte drinkwater in ng/l

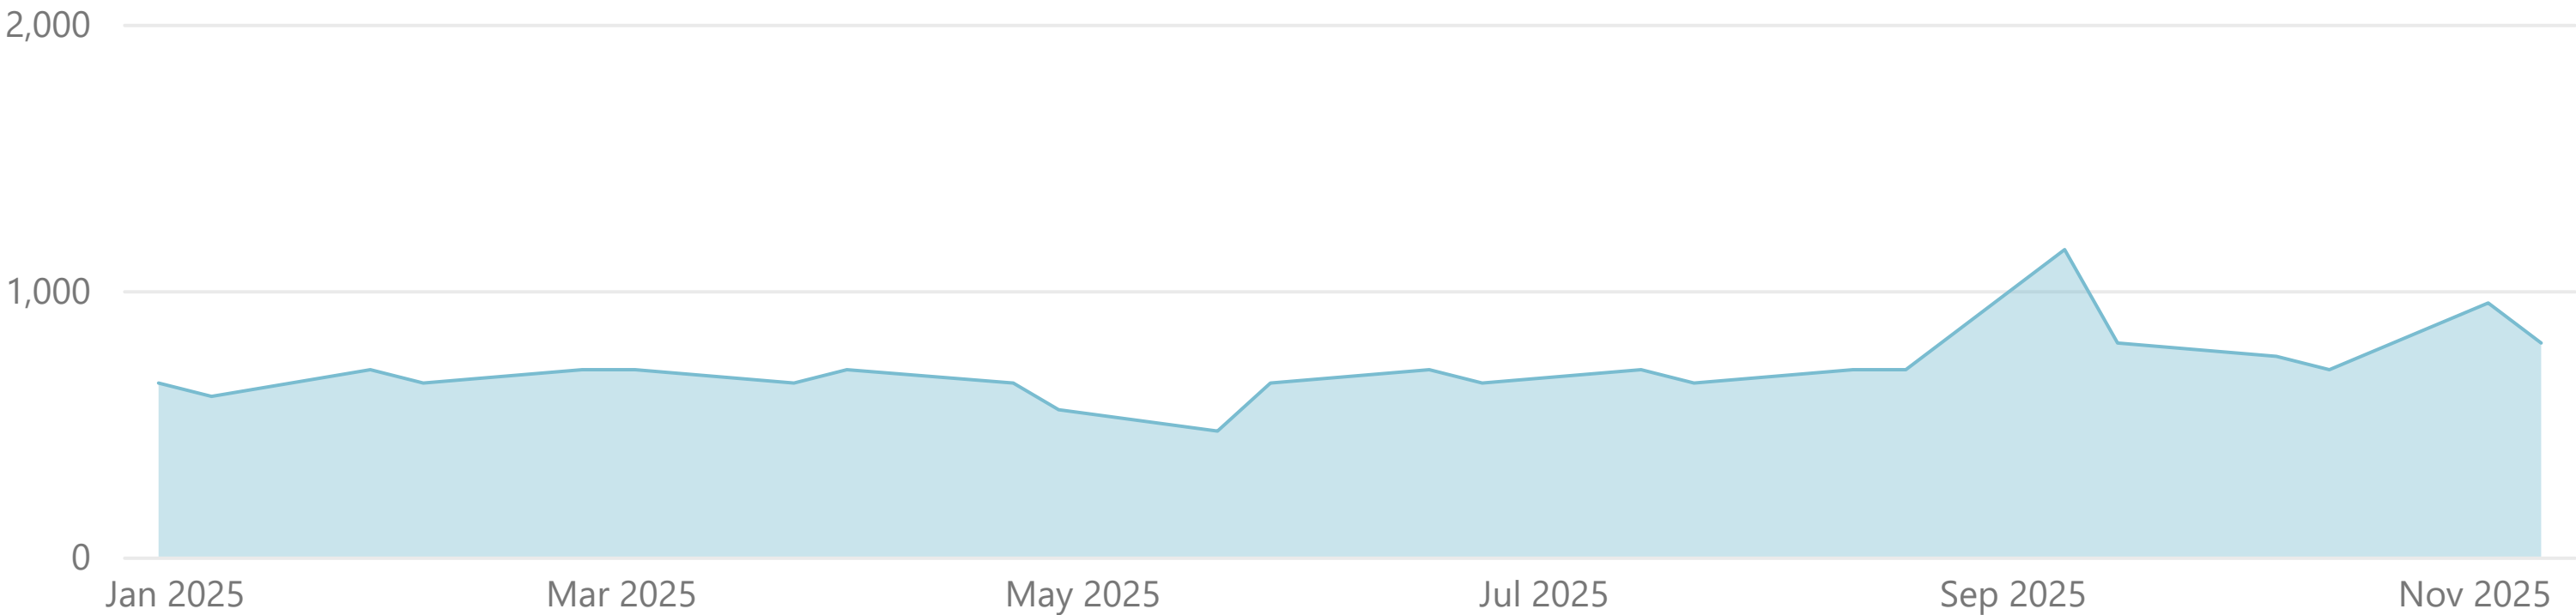

TFA drinkwater in ng/l PFOA equivalenten

Parameternaam (kort)	Type parameter	Aantal	Min	Gem	Max
PEQ TFA	Totaal	24	1.88	2.82	4.60

TFA gehalte drinkwater in ng/l PFOA equivalenten

