

Overzicht periode som EDR20 + NL2 in ng/l
individuele metingen

Minimum

15.3

Gemiddeld

15.7

Maximum

15.9


Parameters PFAS drinkwater in ng/l

Parameternaam (kort)	Type parameter	Aantal	Min	Gem	Max
PFBA-L	EDR	3	10.1	10.4	10.9
PFBS-L	EDR	3	0.6	0.6	0.6
PFDA-L	EDR	3	0.0	0.0	0.0
PFDoDA-L	EDR	3	0.0	0.0	0.0
PFDoDS-L	EDR	3	0.0	0.0	0.0
PFDS-L	EDR	3	0.0	0.0	0.0
PFHpA-L	EDR	3	0.3	0.4	0.4
PFHpS-L	EDR	3	0.0	0.0	0.0
PFHxA-L	EDR	3	0.7	0.9	1.1
PFNS-L	EDR	3	0.0	0.0	0.0
PFPeA-L	EDR	3	0.8	0.9	1.0
PFPeS-L	EDR	3	0.0	0.1	0.3
PFTrDA-L	EDR	3	0.0	0.0	0.0
PFTrDS-L	EDR	3	0.0	0.0	0.0
PFUnDA-L	EDR	3	0.0	0.0	0.0
PFUnDS-L	EDR	3	0.0	0.0	0.0
PFHxS-L+V	EFSA-4	3	0.4	0.5	0.5
PFNA-L	EFSA-4	3	0.0	0.0	0.0
PFOA-L+V	EFSA-4	3	1.8	2.0	2.2
PFOS-L+V	EFSA-4	3	0.0	0.0	0.0
DONA	NL	3	0.0	0.0	0.0
HFPO-DA	NL	3	0.0	0.0	0.0

Maand gemiddelde EDR20 + NL2 drinkwater in ng/l

Jaar	2024	2025	
	202411	202502	202505
Som EDR	13.5	13.0	13.2
Som EFSA-4	2.3	2.3	2.7
Som NL2	0.0	0.0	0.0
Som EDR20 + NL2	15.8	15.3	15.9

Som EDR20 + NL2 drinkwater in ng/l (som onderstaande typen)

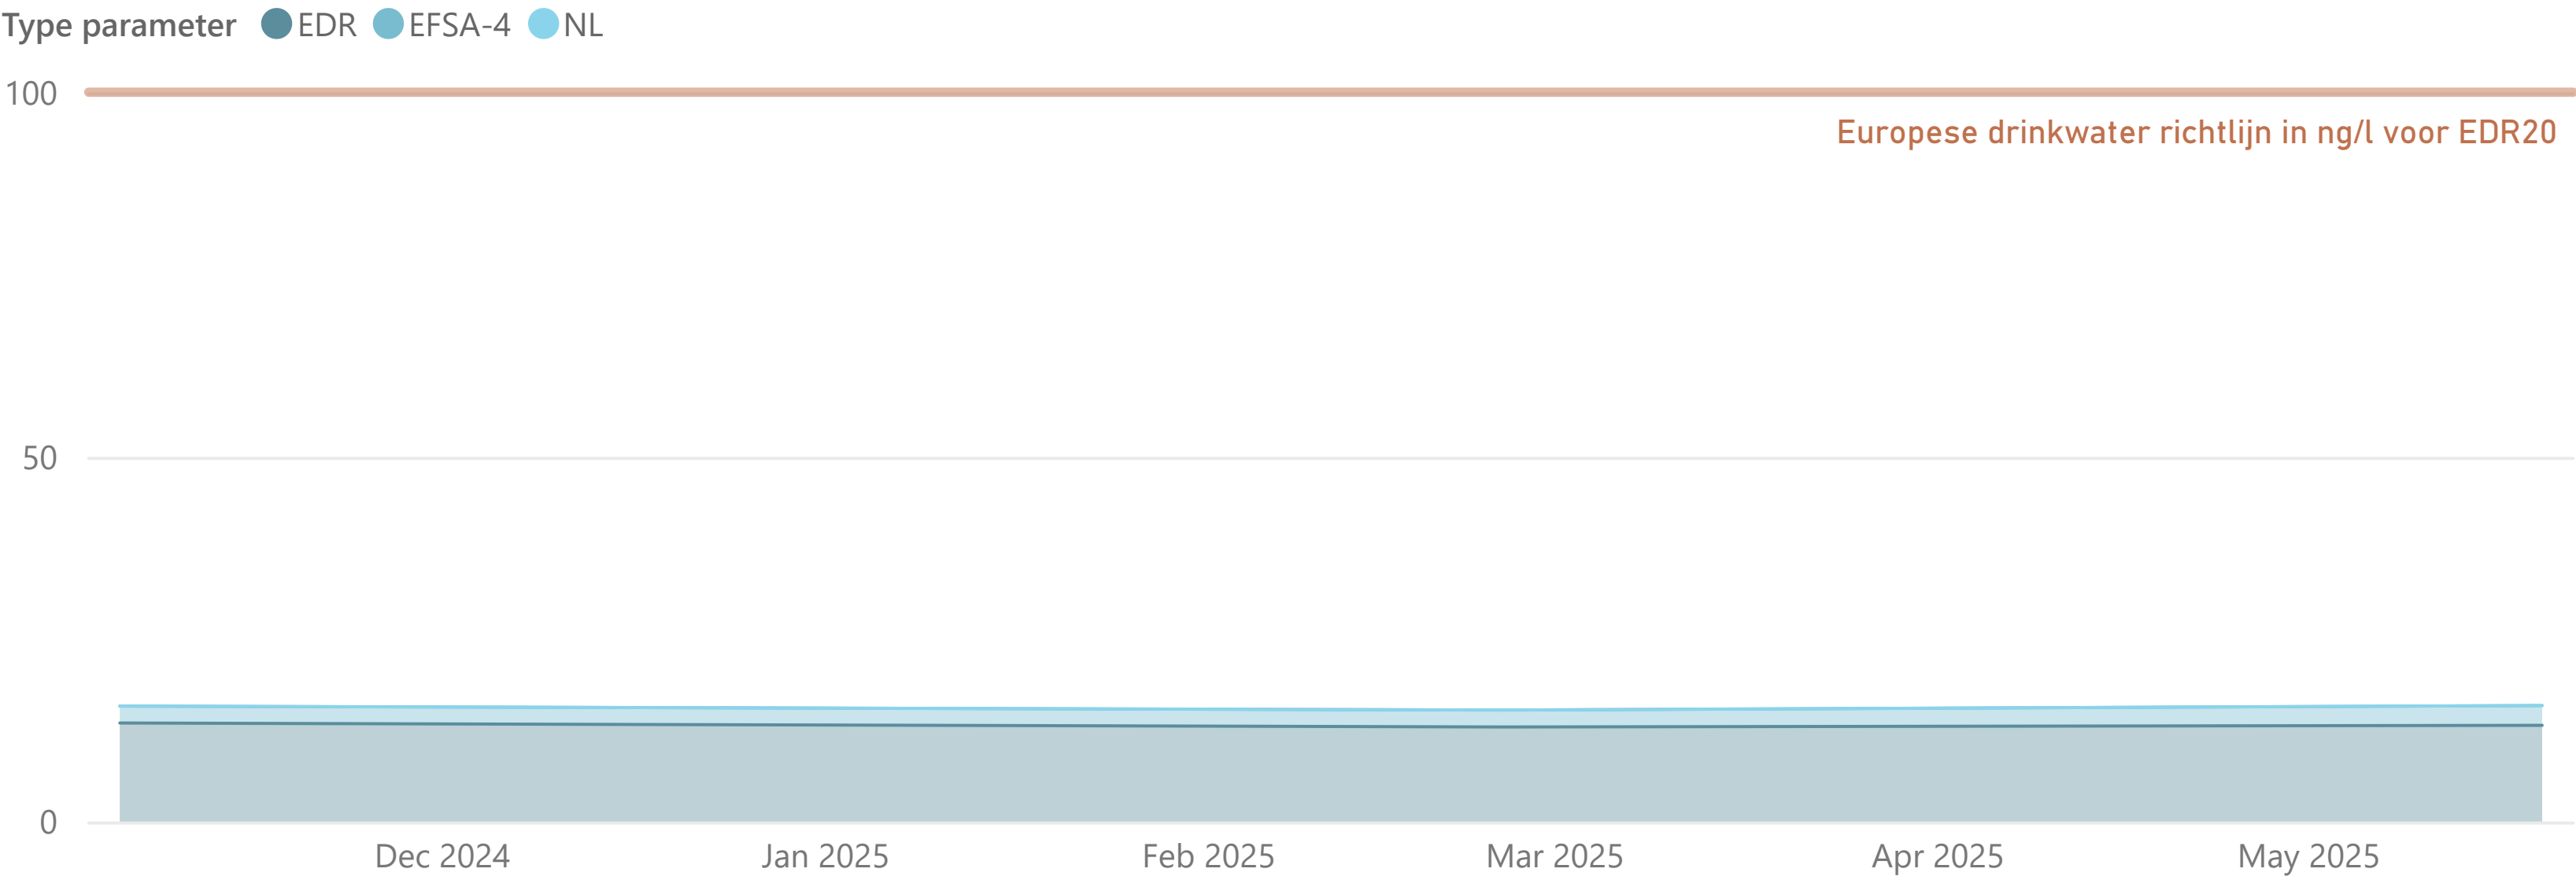

De som EDR20 is een optelling van de som EDR + som EFSA-4

Overzicht periode som EDR20 + NL2 in ng/l PFOA eq
individuele metingen

Minimum

3.1

Gemiddeld

3.3

Maximum

3.5

Maand gemiddelde EDR20 + NL2 drinkwater in ng/l PFOA equivalenten


Jaar	2024	2025	
	202411	202502	202505
Som EDR	1.0	1.1	1.0
Som EFSA-4	2.1	2.2	2.5
Som NL2	0.0	0.0	0.0
Som EDR20 + NL2	3.1	3.2	3.5

Parameters PFAS drinkwater in ng/l PFOA equivalenten

Parameternaam (kort)	Type parameter	Aantal	Min	Gem	Max
PEQ PFBA-L	EDR	3	0.5	0.5	0.5
PEQ PFBS-L	EDR	3	0.0	0.0	0.0
PEQ PFDA-L	EDR	3	0.0	0.0	0.0
PEQ PFDoDA-L	EDR	3	0.0	0.0	0.0
PEQ PFDS-L	EDR	3	0.0	0.0	0.0
PEQ PFHpA-L	EDR	3	0.3	0.4	0.4
PEQ PFHpS-L	EDR	3	0.0	0.0	0.0
PEQ PFHxA-L	EDR	3	0.0	0.0	0.0
PEQ PFPeA-L	EDR	3	0.0	0.0	0.1
PEQ PFPeS-L	EDR	3	0.0	0.1	0.2
PEQ PFTTrDA-L	EDR	3	0.0	0.0	0.0
PEQ PFUnDA-L	EDR	3	0.0	0.0	0.0
PEQ PFHxS-L+V	EFSA-4	3	0.2	0.3	0.3
PEQ PFNA-L	EFSA-4	3	0.0	0.0	0.0
PEQ PFOA-L+V	EFSA-4	3	1.8	2.0	2.2
PEQ PFOS-L+V	EFSA-4	3	0.0	0.0	0.0
PEQ DONA	NL	3	0.0	0.0	0.0
PEQ HFPO-DA	NL	3	0.0	0.0	0.0

Som EDR20 + NL2 drinkwater in ng/l PFOA equivalenten (som onderstaande 3 typen)

Type parameter ● EDR ● EFSA-4 ● NL

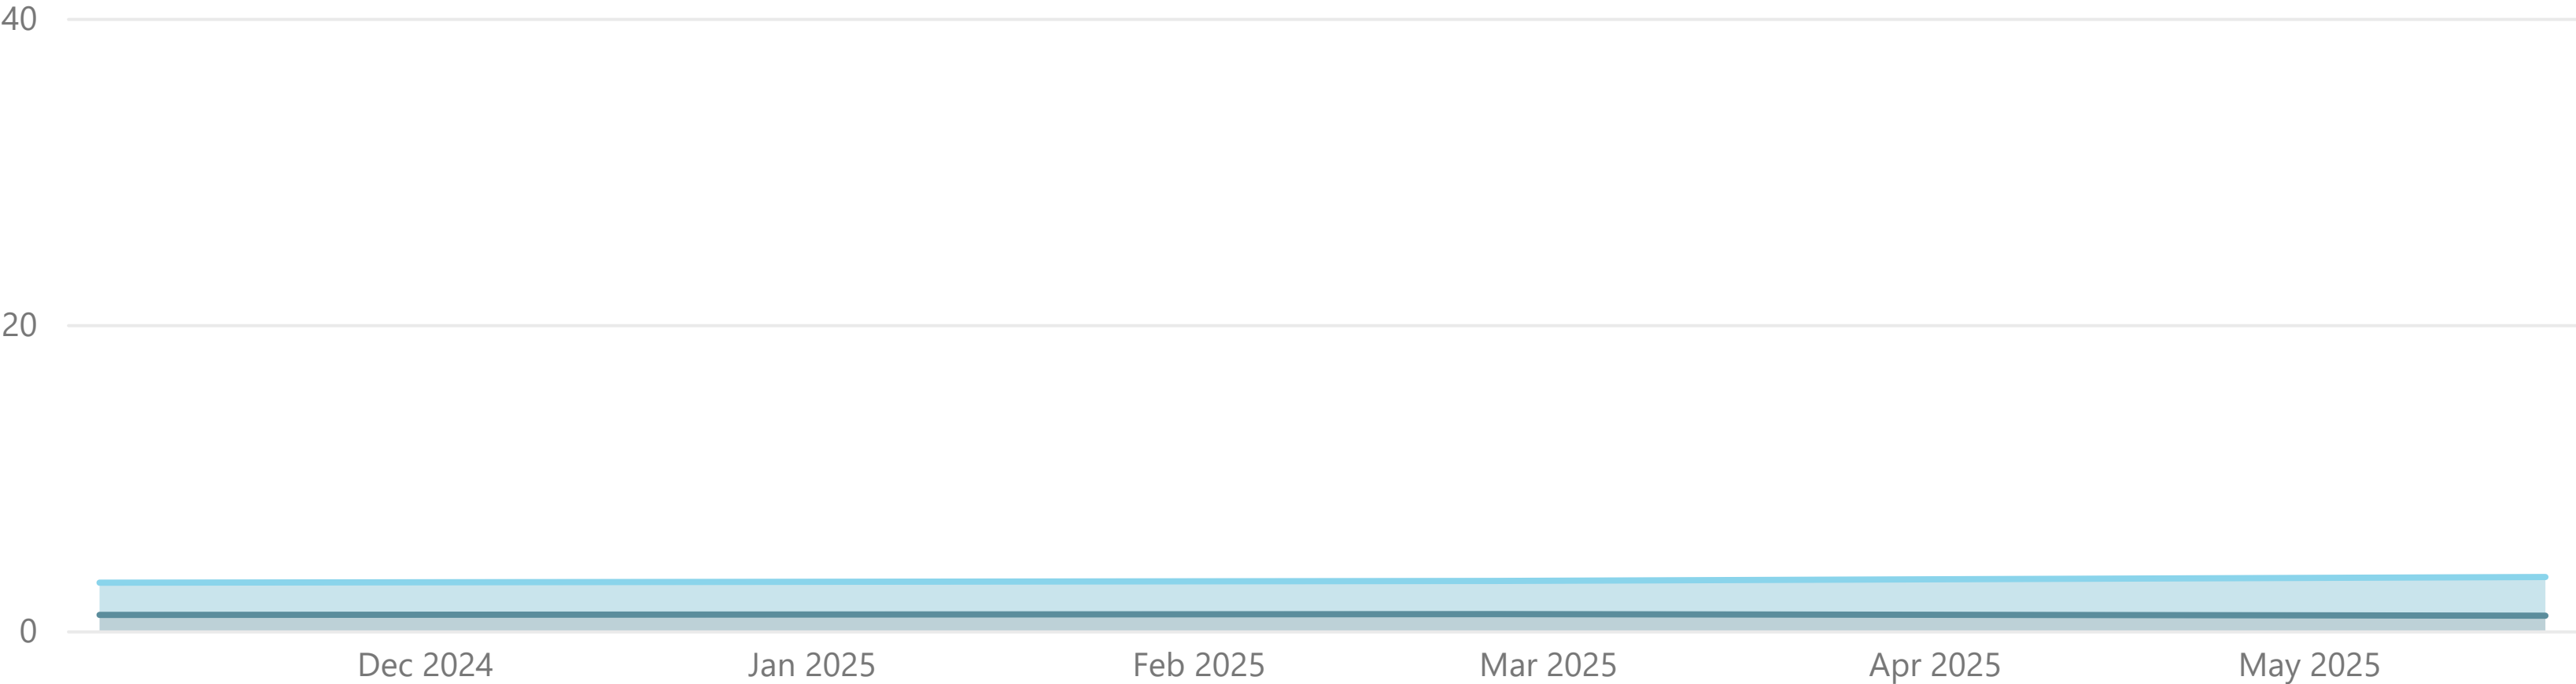


De som EDR20 is een optelling van de som EDR + som EFSA-4

TFA drinkwater in ng/l

Parameternaam (kort)	Type parameter	Aantal	Min	Gem	Max
TFA	Totaal	3	170	180	190

TFA gehalte drinkwater in ng/l

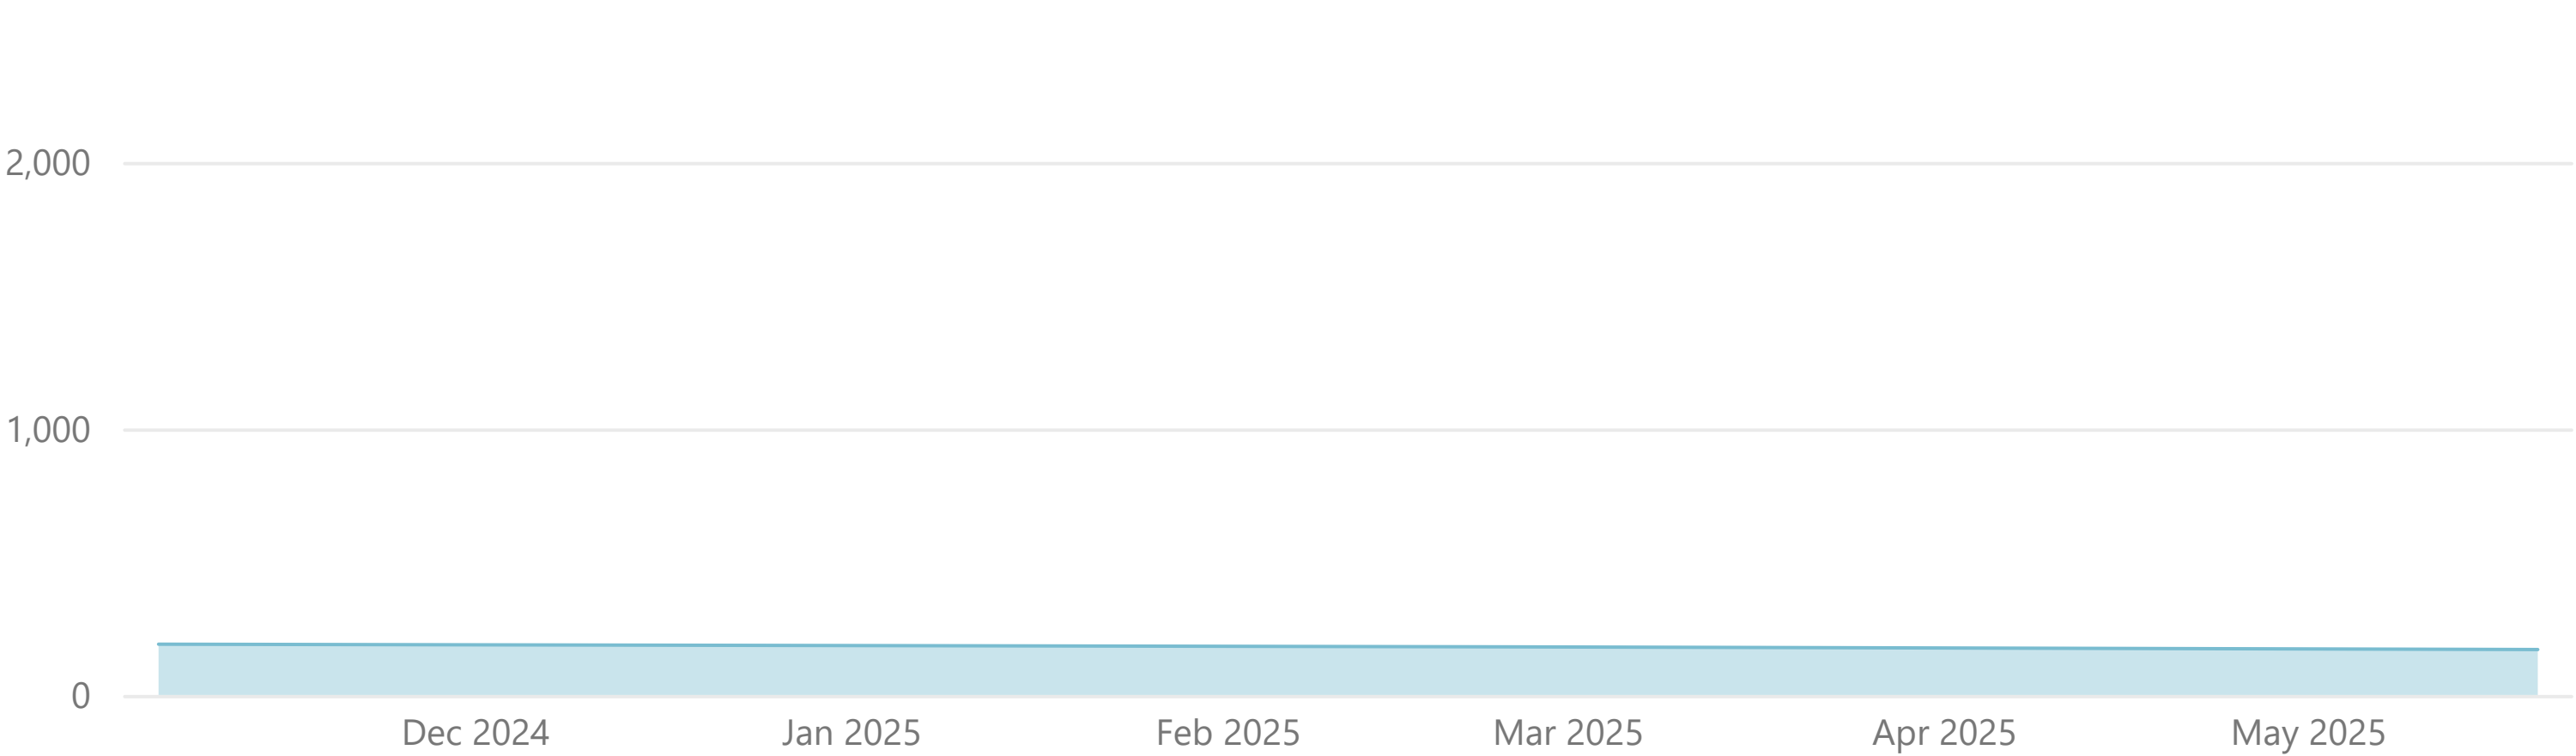

TFA drinkwater in ng/l PFOA equivalenten

Parameternaam (kort)	Type parameter	Aantal	Min	Gem	Max
PEQ TFA	Totaal	3	0.34	0.36	0.38

TFA gehalte drinkwater in ng/l PFOA equivalenten

