

Overzicht periode som EDR20 + NL2 in ng/l
individuele metingen

Minimum

0.1

Gemiddeld

1.1

Maximum

1.8


Parameters PFAS drinkwater in ng/l

Parameternaam (kort)	Type parameter	Aantal	Min	Gem	Max
PFBA-L	EDR	3	0.0	0.8	1.3
PFBS-L	EDR	3	0.1	0.1	0.2
PFDA-L	EDR	3	0.0	0.0	0.0
PFDODA-L	EDR	3	0.0	0.0	0.0
PFDODS-L	EDR	3	0.0	0.0	0.0
PFDS-L	EDR	3	0.0	0.0	0.0
PFHpA-L	EDR	3	0.0	0.0	0.0
PFHpS-L	EDR	3	0.0	0.0	0.0
PFHxA-L	EDR	3	0.0	0.2	0.4
PFNS-L	EDR	3	0.0	0.0	0.0
PFPeA-L	EDR	3	0.0	0.0	0.0
PFPeS-L	EDR	3	0.0	0.0	0.0
PFTTrDA-L	EDR	3	0.0	0.0	0.0
PFTTrDS-L	EDR	3	0.0	0.0	0.0
PFUnDA-L	EDR	3	0.0	0.0	0.0
PFUnDS-L	EDR	3	0.0	0.0	0.0
PFHxS-L+V	EFSA-4	3	0.0	0.0	0.0
PFNA-L	EFSA-4	3	0.0	0.0	0.0
PFOA-L+V	EFSA-4	3	0.0	0.0	0.0
PFOS-L+V	EFSA-4	3	0.0	0.0	0.0
DONA	NL	3	0.0	0.0	0.0
HFPO-DA	NL	3	0.0	0.0	0.0

Maand gemiddelde EDR20 + NL2 drinkwater in ng/l

Jaar	2024	2025	
	202411	202502	202505
Som EDR	1.4	0.1	1.8
Som EFSA-4	0.0	0.0	0.0
Som NL2	0.0	0.0	0.0
Som EDR20 + NL2	1.4	0.1	1.8

Som EDR20 + NL2 drinkwater in ng/l (som onderstaande typen)

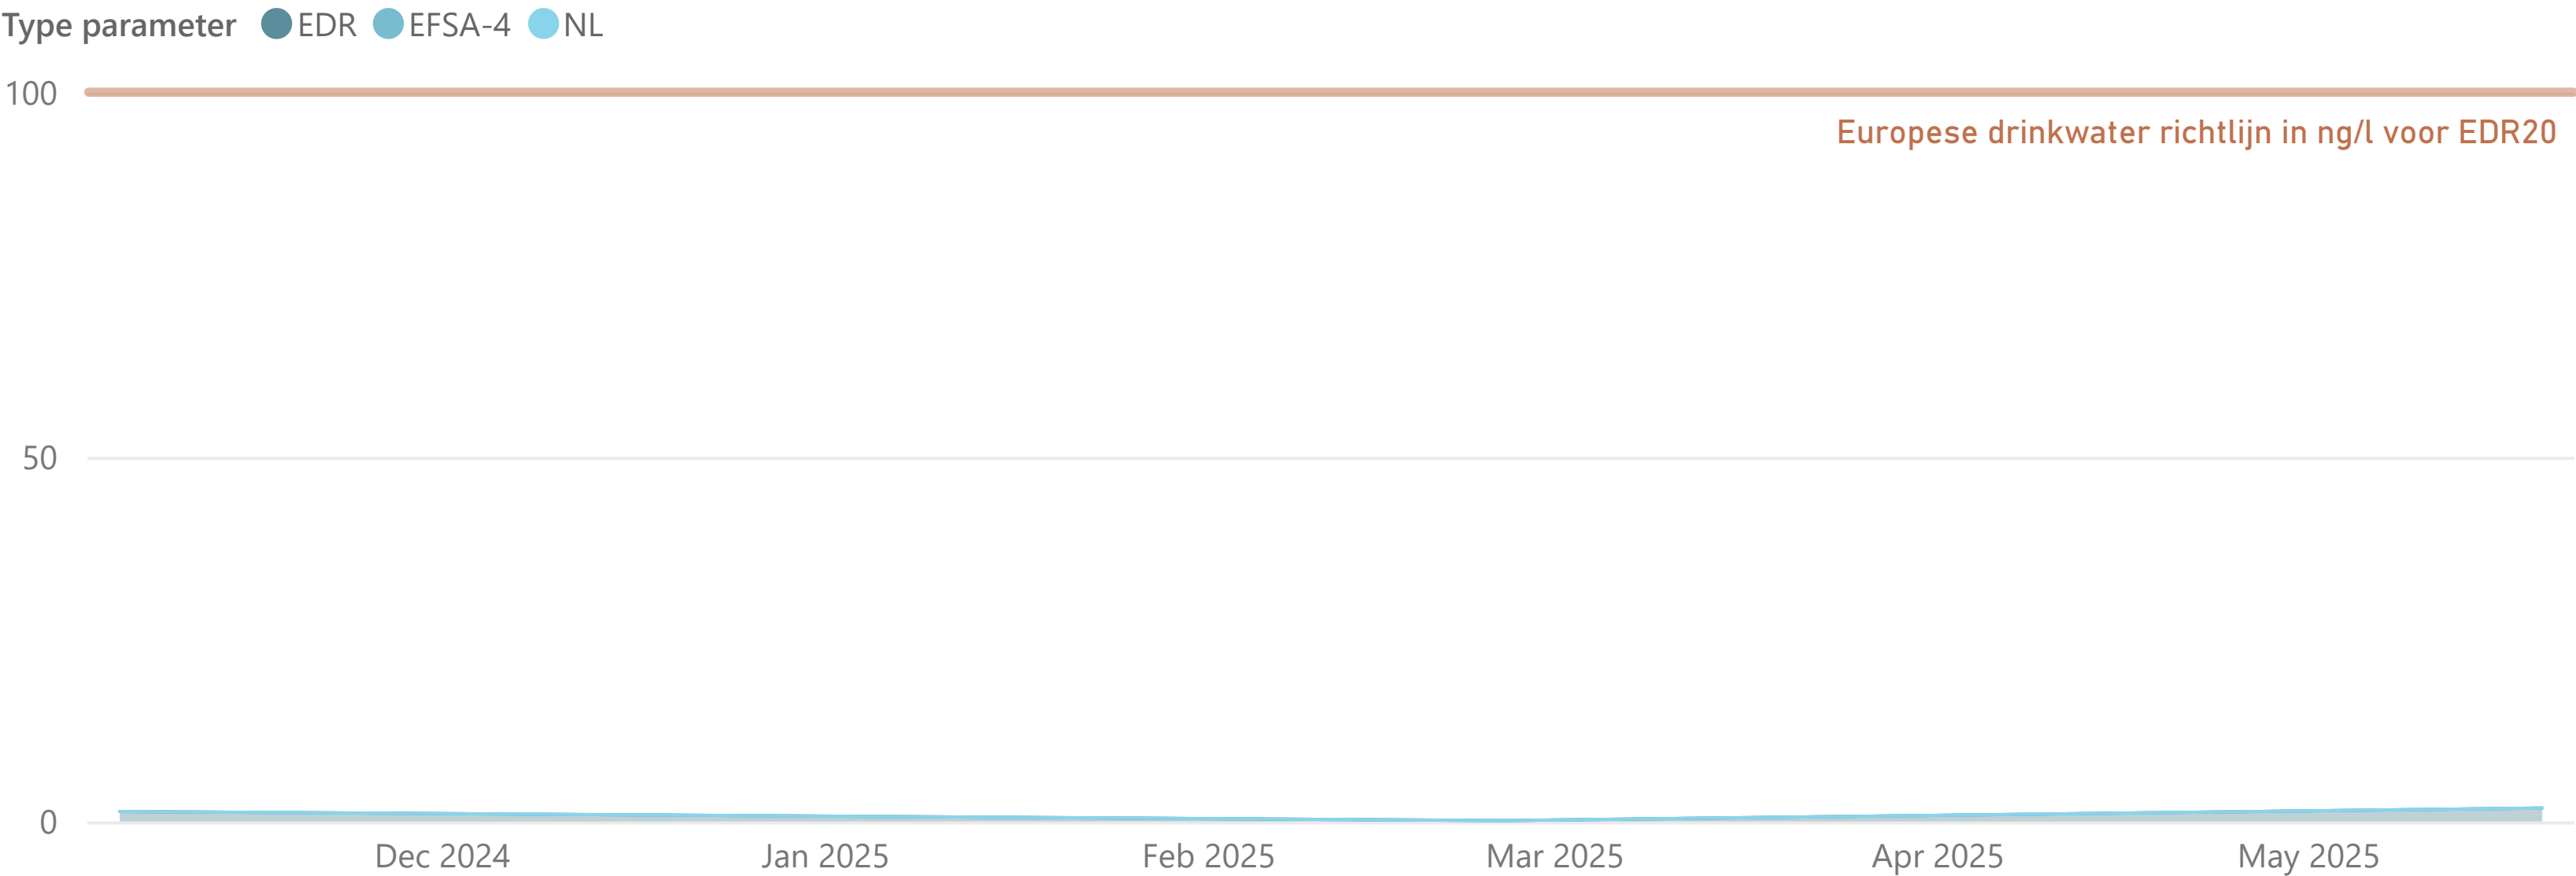

De som EDR20 is een optelling van de som EDR + som EFSA-4

Overzicht periode som EDR20 + NL2 in ng/l PFOA eq
individuele metingen

Minimum

0.0

Gemiddeld

0.0

Maximum

0.1

Maand gemiddelde EDR20 + NL2 drinkwater in ng/l PFOA equivalenten


Jaar	2024	2025	
	202411	202502	202505
Som EDR	0.1	0.0	0.1
Som EFSA-4	0.0	0.0	0.0
Som NL2	0.0	0.0	0.0
Som EDR20 + NL2	0.1	0.0	0.1

Parameters PFAS drinkwater in ng/l PFOA equivalenten

Parameternaam (kort)	Type parameter	Aantal	Min	Gem	Max
PEQ PFBA-L	EDR	3	0.0	0.0	0.1
PEQ PFBS-L	EDR	3	0.0	0.0	0.0
PEQ PFDA-L	EDR	3	0.0	0.0	0.0
PEQ PFDoDA-L	EDR	3	0.0	0.0	0.0
PEQ PFDS-L	EDR	3	0.0	0.0	0.0
PEQ PFHpA-L	EDR	3	0.0	0.0	0.0
PEQ PFHpS-L	EDR	3	0.0	0.0	0.0
PEQ PFHxA-L	EDR	3	0.0	0.0	0.0
PEQ PFPeA-L	EDR	3	0.0	0.0	0.0
PEQ PFPeS-L	EDR	3	0.0	0.0	0.0
PEQ PFTTrDA-L	EDR	3	0.0	0.0	0.0
PEQ PFUnDA-L	EDR	3	0.0	0.0	0.0
PEQ PFHxS-L+V	EFSA-4	3	0.0	0.0	0.0
PEQ PFNA-L	EFSA-4	3	0.0	0.0	0.0
PEQ PFOA-L+V	EFSA-4	3	0.0	0.0	0.0
PEQ PFOS-L+V	EFSA-4	3	0.0	0.0	0.0
PEQ DONA	NL	3	0.0	0.0	0.0
PEQ HFPO-DA	NL	3	0.0	0.0	0.0

Som EDR20 + NL2 drinkwater in ng/l PFOA equivalenten (som onderstaande 3 typen)

Type parameter ● EDR ● EFSA-4 ● NL

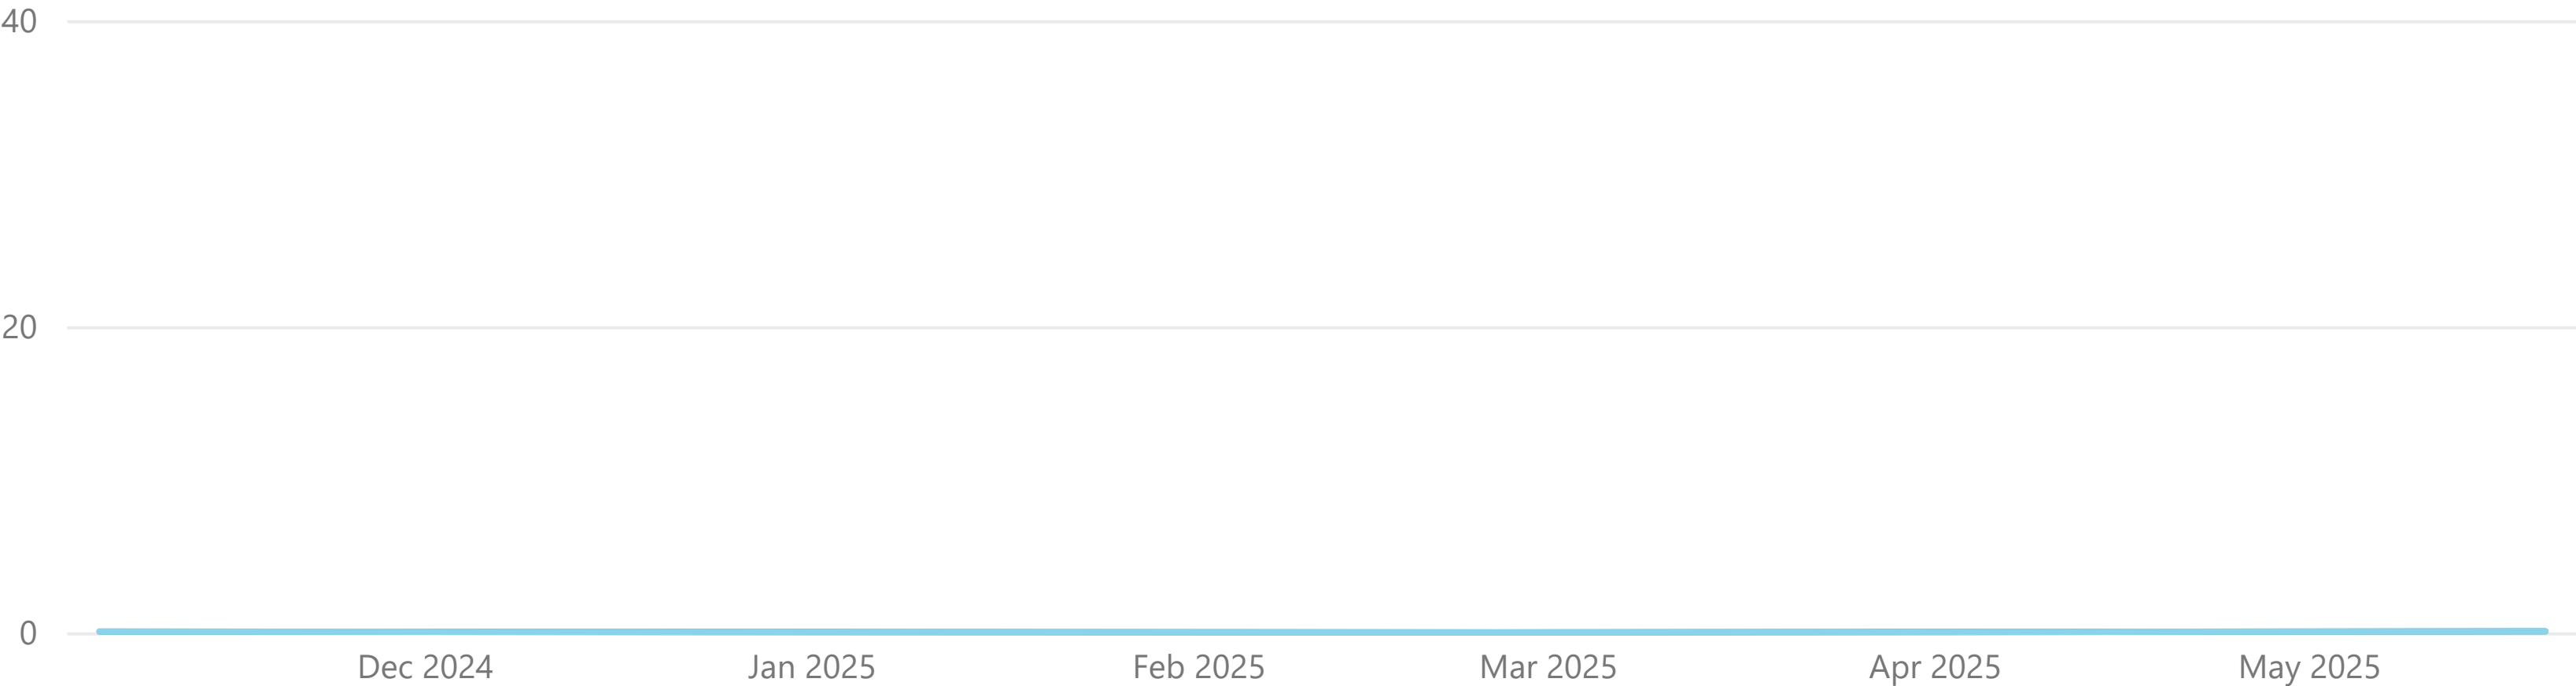


De som EDR20 is een optelling van de som EDR + som EFSA-4



TFA drinkwater in ng/l

Parameternaam (kort)	Type parameter	Aantal	Min	Gem	Max
TFA	Totaal	3	0	0	0

TFA gehalte drinkwater in ng/l

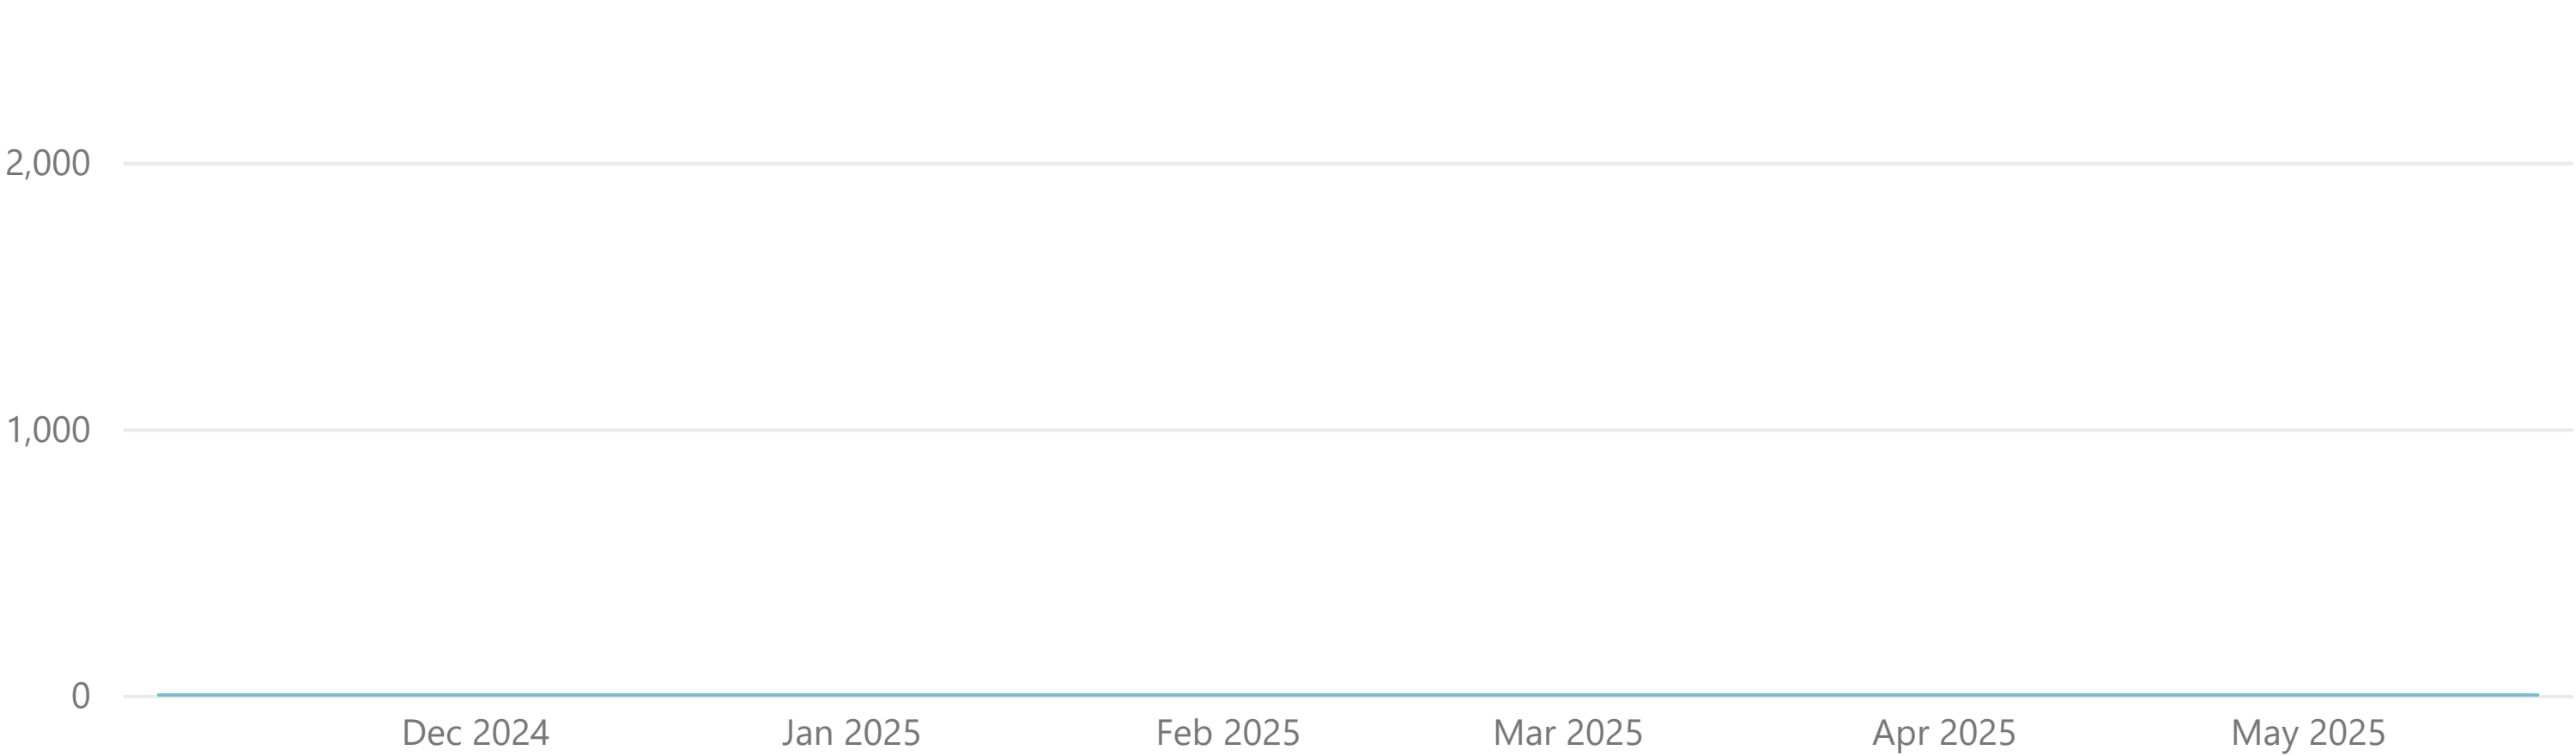

TFA drinkwater in ng/l PFOA equivalenten

Parameternaam (kort)	Type parameter	Aantal	Min	Gem	Max
PEQ TFA	Totaal	3	0.00	0.00	0.00

TFA gehalte drinkwater in ng/l PFOA equivalenten

